


## BREAKROOM

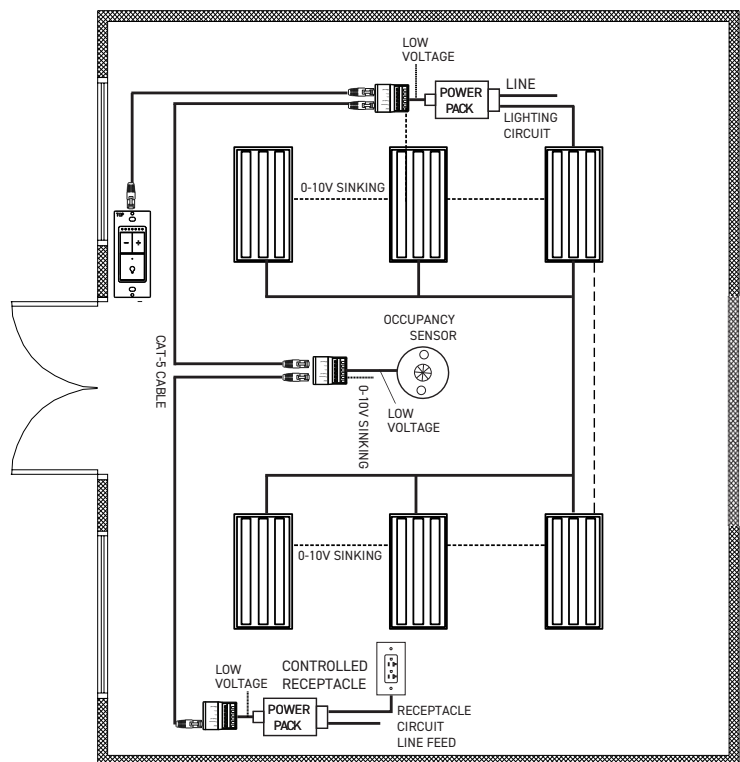

### LIST OF DEVICES

|  |                                                         |   |
|--|---------------------------------------------------------|---|
|  | 20A 120-277V Power Pack<br>MPP-24                       | 2 |
|  | Multi-Tech Ceiling Mount<br>Occupancy Sensor<br>MDC-50L | 1 |
|  | Low Voltage 0-10V Dimmer<br>LVD-101                     | 1 |
|  | Low Voltage to Cat-5 coupler<br>LV-Cat5                 | 3 |
|  | 20A 125V Half-Controlled<br>Receptacle<br>63200-TR-PLH  | 6 |

### FEATURES

- Decorator dimmer
- 0-10V Dimming Control
- Vacancy or Occupancy Sensing with Auto-OFF
- Plug Load Control with Power Pack

Note: 50% of all receptacles in applicable spaces must be controlled by an occupancy sensor.

### Meets the Following Requirements:

- Section 8.4.2
  - Automatic Receptacle Control
- Section 9.4.1.1
  - Interior Lighting Control
- Section 9.4.1
  - Lighting Control